

American WHEATLEY HVAC PRODUCTS®

COMMERCIAL HOT WATER STORAGE TANKS GLASS LINED



The Commercial Storage Tank Models Feature:

- **Applications**—Designed for use with boilers, hot water circulation systems and large dump volume applications.
- **Uitonium® Lining**—Water heater tanks are protected from the corrosive effects of hot water by an exclusive ceramic porcelain-like coating. The high silica Uitonium® lining provides a tough interior surface for our hot water tanks.
- **Optional ASME Construction Available.**
- **2" Non-CFC Foam Insulation**—Covers the sides and top of tank, reducing the amount of heat loss. This results in less energy consumption, improved operation efficiencies and jacket rigidity.
- **Water Connections**—2" NPT factory installed true dielectric fittings extend water heater life and eases installation.
 - JS-24-80 - 2" JS-28-120A - 2½"
 - JS-24-80A - 2" JS-32-200 - 2½"
 - JS-28-120 - 2"
- **Rear Connection**—2" NPT spud allows for a rear water connection (JS-28-120 and JS-28-120A only).
- **Hand Hole Cleanout**—For removal of accumulated lime and sediment (JS-28-120 has optional hand hole cleanout).
- **Two Protective Magnesium Anode Rods**—Provide added protection against corrosion for long trouble-free service.
- **Steel Tank**—Heavy gauge steel automatically formed, rolled, and welded.
- **T&P Relief Valve Opening (T&P Not Supplied)**—All models have special tapping on side of tank.
- **3/4" NPT Aquastat Fitting.**
- **Brass Drain Valve.**

JOB NAME _____
LOCATION _____
CONTRACTOR _____
CONTRACTOR P.O. NO. _____

ITEMS	QUANTITY
_____	_____
_____	_____
_____	_____
_____	_____
_____	_____



1005 E. Houston
Broken Arrow, OK 74012
Toll Free: 866-204-5229
PH: 918-317-0401
FAX: 918-317-0407
www.wheatleyhvac.com
e-mail: sales@globalflowproducts.com

Commercial Storage Tanks


Jacketed Commercial Storage Models

Meet or exceed ASHRAE 90.1b (current standard)

Model Number	Capacity		A Floor to Heater Top in.	B Jacket Dia. in.	C Floor to T&P Conn. in.	D Floor to Hot Water Conn. in.	E Floor to Aquastat & Top Circ. Conn. in.	F Floor to Bottom Circ. Conn. in.	G Floor to Drain in.	H Floor to Hand Hole Cleanout in.	J Floor to Rear Water Conn. in.	Water Conn. Size.† in.	Approx. Shipping Weight lbs.
	U.S. Gal.	Imp. Gal.											
JS-24-80	80	67	58 ³ / ₄	24	52 ¹ / ₂	59 ³ / ₄	14 ¹ / ₄	9 ¹ / ₄	4 ³ / ₄	7 ¹ / ₄	—	2(F)	192
JS-24-80A*	80	67	58 ³ / ₄	24	52 ¹ / ₂	59 ³ / ₄	14 ¹ / ₄	9 ¹ / ₄	4 ³ / ₄	7 ¹ / ₄	—	2(F)	192
JS-28-120	119	100	62 ¹ / ₂	28	55 ³ / ₄	63 ¹ / ₂	14 ¹ / ₂	9 ¹ / ₂	5	—	5	2(F), 2(R)	312
JS-28-120A*	119	100	62 ¹ / ₂	28	55 ³ / ₄	63 ¹ / ₂	14 ¹ / ₂	9 ¹ / ₂	5	7 ¹ / ₂	5	2 ¹ / ₂ (F), 2(R)	366
JS-32-200*	200	167	77	32	66	78	16 ¹ / ₄	11 ¹ / ₄	6 ³ / ₄	9 ¹ / ₄	—	2 ¹ / ₂ (F)	541

Model Number	Capacity		A Floor to Heater Top mm.	B Jacket Dia. mm.	C Floor to T&P Conn. mm.	D Floor to Hot Water Conn. mm.	E Floor to Aquastat & Top Circ. Conn. mm.	F Floor to Bottom Circ. Conn. mm.	G Floor to Drain mm.	H Floor to Hand Hole Cleanout mm.	J Floor to Rear Water Conn. mm.	Water Conn. Size.† mm.	Approx. Shipping Weight kg.
	Liters												
JS-24-80	303		1492	610	1334	1518	362	235	121	184	—	51(F)	87
JS-24-80A*	303		1492	610	1334	1518	362	235	121	184	—	51(F)	87
JS-28-120	450		1588	711	1416	1613	368	241	127	—	127	51(F), 51(R)	142
JS-28-120A*	450		1588	711	1416	1613	368	241	127	191	127	64(F), 51(R)	166
JS-32-200*	751		1956	813	1676	1981	413	286	171	235	—	64(F)	245

*Meets American Society of Mechanical Engineers (ASME) Code.
†F=Front Water Connections. R= Rear Water Connections.

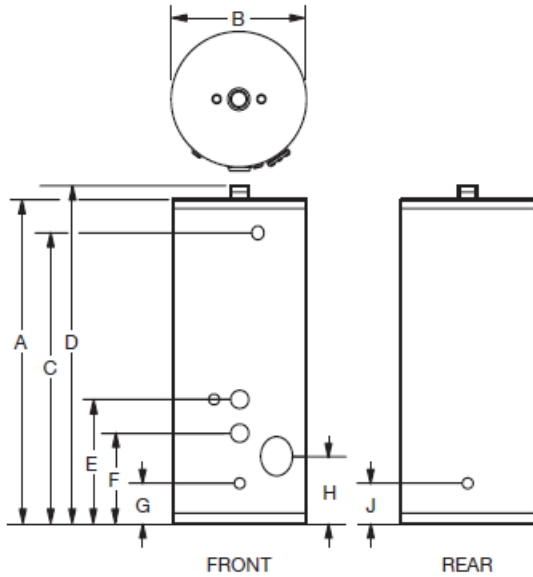

General

All water connections are 2" (50.8mm.) NPT except for JS-28-120A and JS-32-200 which are 2¹/₂" (63.5mm.) NPT. T&P tapping 1" (25mm.) NPT. Aquastat tapping 3/4" (19mm.) NPT. Certified at 300 psi (2068 kPa) test pressure and 150 psi 1034 (kPa) working pressure.

Dimensions and specifications subject to change without notice in accordance with our policy of continuous product improvement.

Sample Specification

The hot water storage tank shall be a Niles Steel Tank model _____ with a storage capacity of not less than _____ gallons/liters. The tank shall be lined with Ultronium™ vitreous enamel and shall have a bolted hand hole cleanout. The tank shall have two extruded magnesium rods installed in separate head couplings. The storage tank shall be insulated with not less than 2" of Non-CFC foam. The entire installation shall be made in compliance with state and local codes and ordinances.

JOB NAME _____
 LOCATION _____

 CONTRACTOR _____
 CONTRACTOR P.O. NO. _____

ITEMS	QUANTITY



1005 E. Houston
 Broken Arrow, OK 74012
 Toll Free: 866-204-5229
 PH: 918-317-0401
 FAX: 918-317-0407
 www.wheatleyhvac.com
 e-mail: sales@globalflowproducts.com